



Interconnection Feasibility Study Report Request # GI-2016-19

150 MW Wind Generating Facility
Interconnecting at
Missile Site 345 kV Substation, Colorado

Public Service Company of Colorado
Transmission Planning
April 4, 2017

Executive Summary

Public Service Company of Colorado (PSCo) received an Interconnection Request (IR) on September 6, 2016 which was assigned GI-2016-19 queue position. GI-2016-19 is a wind generating facility rated at 150 MW gross electrical output that will be located in Lincoln County, Colorado. GI-2016-19 would physically interconnect to PSCo's planned Pronghorn Switching Station as a part of the Rush Creek Wind Project's Missile Site – Rush Creek 345 kV radial transmission line, i.e. the "Gen-Tie" (for GI-2016-3) expected to be constructed by August 2018. (The Pronghorn Switching Station has previously been referred to as the Rush Creek I site.) However, the Point Of Interconnection (POI) for GI-2016-19 is the 345 kV bus within the Missile Site Substation, which is the point at which power from the generating facility is delivered to the PSCo transmission system. As per the IR, GI-2016-19 is studied for both Network Resource Interconnection Service (NRIS) and Energy Resource Interconnection Service (ERIS).

The proposed 150 MW generating facility is expected to consist of approximately 65 wind turbine generators where each turbine is rated 2.3 MW and grouped in branches. Preliminary information on the wind generating facility's layout suggests that it will consist of one 34.5 kV collector system and will connect to a 34.5/345 kV main step-up transformer. The facility will connect to the Pronghorn Switching Station via an approximately 6 mile 345 kV transmission line. The generating facility will ultimately interconnect to the Missile Site POI through the Rush Creek Gen-Tie.

The Commercial Operation Date (COD) requested for the generating facility is December 1, 2019. Based on the requested COD, the assumed back-feed date for the facility is June 1, 2019 (approximately six months before the COD).

Figure 1 below depicts the proposed POI for GI-2016-19 and the surrounding PSCo transmission system.

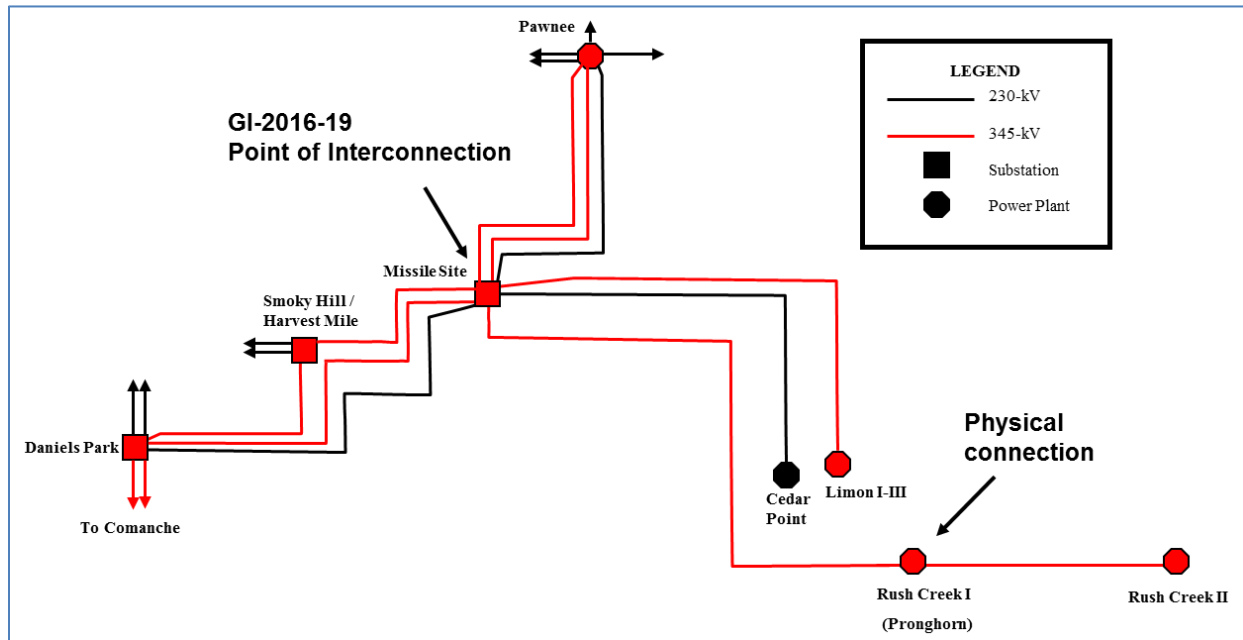


Figure 1: Missile Site and Surrounding Transmission System

The purpose of this Feasibility Study is to determine the feasibility of aggregate injection at the Missile Site 345 kV POI (for delivery to PSCo network loads) resulting from the proposed 150 MW output of GI-2016-19 in addition to the planned 600 MW output from GI-2016-3, which has the same POI, was assumed to be in service and in the models. Towards this purpose, the study also identifies the transmission improvements needed to enable delivery of the combined 750 MW electrical output to PSCo network loads – that is, network upgrades needed for GI-2016-19 to qualify as NRIS.

The 150 MW electrical output of GI-2016-19 IR was studied as a stand-alone project. That is, the study did not include any prior-queued IR's existing in PSCo's or any affected party's Generation Interconnection queue except those IR's which are:

- a) considered to be PSCo planned resources in recognition of their signed Power Purchase Agreements, or
- b) assumed in-service as per the agreed-upon study assumptions with the Interconnection Customer.

The Feasibility Study consisted of steady state (power flow) and short-circuit analyses. The power flow analyses were performed using two power flow models developed for GI-2016-19, both of which are based on the WECC 2021 heavy summer (2021HS) base case. The two power flow models are:

- Benchmark Case which models the planned 2021 transmission system prior to the GI-2016-19 interconnection (i.e. Before GI-2016-19 case).
- Study Case that also models the 150 MW output of the proposed GI-2016-19 interconnection (i.e. After GI-2016-19 case).



The Pawnee – Daniels Park 345 kV project¹ is a PSCo planned project for which the Colorado Public Utility Commission (CPUC) has approved a Certificate of Public Convenience and Necessity (CPCN) and has an in-service date of October 31, 2019. Studies for GI-2016-3 demonstrated that the Pawnee – Daniels Park project is the network upgrade needed to deliver the 600 MW to the PSCo system. Therefore, that project was included in the power flow models.

The studies indicated that there were no adverse impacts to other systems. However, Tri-State Generation and Transmission Association (Tri-State) has requested to be included as an “affected party” for all IR’s with physical interconnections at or near the Rush Creek project, due to the proximity of their transmission system. Therefore, Tri-State is an affected party for GI-2016-19.

This Feasibility Study showed that the additional 150 MW generation injection into Missile Site Substation has the potential to overload the Greenwood – Monaco 230 kV line following the loss of the Smoky Hill – Leetsdale 230 kV line. Results are shown in the power flow analysis results provided in Table A.1 in the Appendix (see page 12). Therefore, a new network upgrade is required for the proposed GI-2016-19 interconnection to achieve 150 MW NRIS². The network upgrade consists of replacing limiting substation equipment to increase the thermal rating of the Greenwood – Monaco 230 kV line.

Consequently this Feasibility Study concludes that the GI-2016-19 interconnection qualifies for 150 MW NRIS and ERIS (in addition to the 600 MW NRIS of GI-2016-3) provided the Pawnee – Daniels Park 345 kV project along with the identified Greenwood – Monaco 230 kV network upgrade are in service.

Therefore, for GI-2016-19 interconnection:

NRIS (before network upgrades) = 0 MW

ERIS (before network upgrades) = 0 to 150 MW on “as-available” basis

NRIS and/or ERIS (after network upgrades) = 150 MW

As shown in **Tables 1–2**, the cost for the Interconnection Facilities and the Network Upgrades for Delivery is **\$2.419 million** and includes:

- \$2.397 million for PSCo-Owned, Interconnection Customer Funded Interconnection Facilities
- \$0.022 million for PSCo Network Upgrades for Delivery to PSCo Loads

It is estimated that this work can be completed in approximately 18 months, following receipt of authorization to proceed.

¹ More information at: <http://www.transmission.xcelenergy.com/Projects/Colorado>

² Network Resource Interconnection Service allows Interconnection Customer 's Large Generating Facility to be designated as a Network Resource, up to the Large Generating Facility's full output, on the same basis as existing Network Resources interconnected to Transmission Provider's Transmission System, and to be studied as a Network Resource on the assumption that such a designation will occur. (*section 3.2.2 of Attachment N in Xcel Energy OATT*)



Power Flow N-1 Contingency Analysis

The 2021HS base case was updated to dispatch the existing and planned generation within the Pawnee and Missile Site “generation pockets” (i.e. aggregate of generation in the local area) at their respective highest coincident output deemed appropriate for the planning of adequate transmission capacity. This was done in accordance with the generation dispatch assumptions practiced by PSCo Transmission Planning function to study the feasibility and system impact of generator interconnection requests as a Transmission Provider. Accordingly, the existing, planned and proposed generating plants at Pawnee and Missile Site stations were dispatched as noted below.

Pawnee local “generation pocket”

- ✓ Pawnee Fossil Fuel generation = 100% of rated capacity = 536 MW
- ✓ Manchief Gas generation = 90% of rated capacity = 252 MW
- ✓ Peetz Logan Wind generation = 40% of rated capacity = 230 MW

Aggregate Generation Dispatched at Pawnee in all Cases = 1018 MW

Missile Site local “generation pocket”

- ✓ Cedar Point (Missile Site 230kV) = 80% of rated capacity = 200 MW
- ✓ Limon I, II, III (Missile Site 345kV) = 80% of rated capacity = 480 MW
- ✓ GI-2016-3 (Missile Site 345kV) = 100% of rated capacity = 600 MW
- ✓ GI-2016-19 (Missile Site 345kV) = 100% of rated capacity = 150 MW

Aggregate Generation Dispatched at Missile Site in Benchmark Case = 1280 MW

Aggregate Generation Dispatched at Missile Site in Study Case(s) = 1430 MW

The GI-2016-19 *Benchmark Case* was derived from the 2021HS base case by changing the aggregate area generation dispatch at Pawnee and Missile Site to 1280 MW as noted above. The previously proposed GI-2016-3 generating plant was added at the Missile Site 345kV bus and dispatched at 600 MW rated output. Transmission facilities comprising the Pawnee –Daniels Park project modeled in the 2021HS case were retained in the Benchmark Case since they comprise the network upgrades identified for GI-2016-3.

The GI-2016-19 *Study Case* was created by adding the proposed GI-2016-19 wind generating plant in the Benchmark Case (which included GI-2016-3 generation) and dispatching it at 150 MW rated output, thus resulting in 750 MW aggregate generation dispatch from the Rush Creek Gen-Tie at the Missile Site 345kV bus.

PSCo adheres to all applicable NERC Standards and WECC Criteria for Bulk Electric System (BES) acceptable performance, as well as its internal transmission planning criteria for all studies. During system intact (N-0) conditions, PSCo’s steady-state performance criteria require the transmission bus voltages remain within 0.95 – 1.05 per unit of nominal and the power flows stay below the applicable normal ratings of the



transmission facilities. Following a single contingency, the steady state bus voltages must remain within 0.90 – 1.05 per unit of nominal, and the power flows must continue to stay below the applicable normal facility ratings. For N-1 post-contingency system conditions, the applicable normal rating is the seasonal continuous rating of the transmission facility – but PSCo allows use of eight-hour facility rating for transformers for which it is available. Further, PSCo does not rely on 30-minute emergency ratings of transmission facilities for meeting N-1 system performance in planning studies.

As is evident from the power flow analysis results provided in Table A.1 in the Appendix (see page 12), the additional 150 MW generation injection into Missile Site Substation causes an overload of the Greenwood – Monaco 230 kV line following the loss of the Smoky Hill – Leetsdale 230 kV line. Therefore, a network upgrade is required for the proposed GI-2016-19 interconnection to achieve 150 MW NRIS. The network upgrade scope is to replace limiting substation equipment to increase the thermal rating of the Greenwood – Monaco 230 kV line.

Consequently, this Feasibility Study concludes that the proposed GI-2016-19 interconnection qualifies for 150 MW NRIS and ERIS (in addition to the 600 MW NRIS of GI-2016-3) provided the Pawnee – Daniels Park 345 kV project along with the identified Greenwood – Monaco 230 kV network upgrade are in-service.

Therefore, for GI-2016-19 interconnection:

NRIS (before network upgrades) = 0 MW

ERIS (before network upgrades) = 0 to 150 MW on “as-available” basis

NRIS and/or ERIS (after network upgrades) = 150 MW

Voltage Regulation and Reactive Power Capability

Interconnection Customers are required to interconnect its Large Generating Facility with Public Service of Colorado’s (PSCo) Transmission System in accordance with the *Xcel Energy Interconnection Guidelines for Transmission Interconnected Producer-Owned Generation Greater Than 20 MW* (available at: <http://www.transmission.xcelenergy.com/staticfiles/microsites/Transmission/Files/PDF/Interconnection/Interconnections-POL-TransmissionInterconnectionGuidelineGreat20MW.pdf>).

In addition, wind generating plant interconnections must also fulfill the performance requirements specified in FERC Order 661-A. Accordingly, the following voltage regulation and reactive power capability requirements at the POI are applicable to this interconnection request:

- To ensure reliable operation, all Generating Facilities interconnected to the PSCo transmission system are expected to adhere to the *Rocky Mountain Area Voltage Coordination Guidelines (RMAVCG)*. Accordingly, since the POI for this interconnection request is located within Northeast Colorado - Region 7 defined in the *RMAVCG*; the applicable ideal transmission system voltage profile range is 1.02 – 1.03 per unit at regulated buses and 1.0 – 1.03 per unit at non-regulated buses.



- Xcel Energy's OATT (Attachment N effective 10/14/2016) requires all Generator Interconnection (GI) Customers to provide dynamic reactive power within the power factor range of 0.95 leading to 0.95 lagging at the high side of the generator substation. Accordingly, for GI-2016-19, the 0.95 lag – 0.95 lead dynamic reactive power is measured at the metered interface between the Generating Facility and the Interconnection Facilities of the GI Customer – that is, at the metering location shown in the conceptual one-line in Figure 2. Furthermore, Xcel Energy requires every Generating Facility to have dynamic voltage control capability to assist in maintaining the POI voltage schedule specified by the Transmission Operator as long as the Generating Facility does not have to operate outside its 0.95 lag – 0.95 lead dynamic power factor range capability.
- It is the responsibility of the Interconnection Customer to determine the type (switched shunt capacitors and/or switched shunt reactors, etc.), the size (MVAR), and the locations (34.5 kV or 345 kV bus) of any additional static reactive power compensation needed within the generating plant in order to have adequate reactive capability to meet the +/- 0.95 power factor and the 1.02 – 1.03 per unit voltage range standards at the POI. Further, for wind generating plants to meet the LVRT (Low Voltage Ride Through) performance requirements specified in FERC Order 661-A, an appropriately sized and located dynamic reactive power device (DVAR, SVC, etc.) may also need to be installed within the generating plant. Finally, it is the responsibility of the Interconnection Customer to compensate their generation tie-line to ensure minimal reactive power flow under no load conditions.
- The Interconnection Customer is required to demonstrate to the satisfaction of PSCo Transmission Operations prior to the commercial in-service date of the generating plant that it can safely and reliably operate within the required power factor and voltage ranges (noted above).

Short Circuit Analysis

The short circuit study results show that no circuit breakers in the Missile Site Substation (or in PSCo's system) will be over-dutied by interconnecting the proposed GI-2016-19 wind generation facility. The base case scenario before GI-2016-19 included preliminary models for all expected transmission system improvements projected through the end of 2019 and also included preliminary modeling for the proposed GI-2016-3 project. The GI-2016-19 345 kV generator tie line impedance was estimated based on a length of six miles.



GI-2016-19 Impact on Short Circuit Levels and Breaker Duty Margins at Missile Site 345 kV POI

System Condition	Three-Phase (3-Ph) Fault Level (Amps)	Single-Line-to-Ground (SLG) Fault Level (Amps)	Thevenin System Equivalent Impedance (R + jX) (Ohms)
Before GI-2016-19 Y2019	18,574	16,493	Z1(pos)= 0.826 +j 10.692 Z2(neg)= 0.867 +j 10.688 Z0(zero)= 2.210 +j 14.640
After GI-2016-19 Y2019	19,013	16,812	Z1(pos)= 0.812 +j 10.445 Z2(neg)= 0.851 +j 10.441 Z0(zero)= 2.205 +j 14.446

Costs Estimates and Assumptions

PSCo Engineering has developed an Indicative Estimate (IE) for Transmission Provider Interconnection Facilities and Network Upgrades required for the proposed GI-2016-19 Interconnection. The cost estimates are in 2016 dollars with escalation and contingency applied (AFUDC is not included). Indicative Estimates are based upon typical construction costs for previously performed similar construction projects; however they have no specified level of accuracy. These estimated costs include all applicable labor and overheads associated with the siting support, engineering, design, and construction of these new PSCo facilities. These estimates do not include the costs for any other Customer owned equipment and the associated design and engineering.

Figure 2 below represents a conceptual one-line of the proposed interconnection of GI-2016-19 generating facility in the Missile Site Substation 345 kV bus. Figure 3 shows the substation layout of the physical interconnection at Pronghorn Switching Station.

As shown in **Tables 1-2**, the total cost for the Interconnection Facilities and Network Upgrades for Delivery is **\$2.419 million**. The cost responsibilities associated with these facilities shall be handled as per current FERC guidelines. System improvements are subject to change upon a more detailed and refined design.

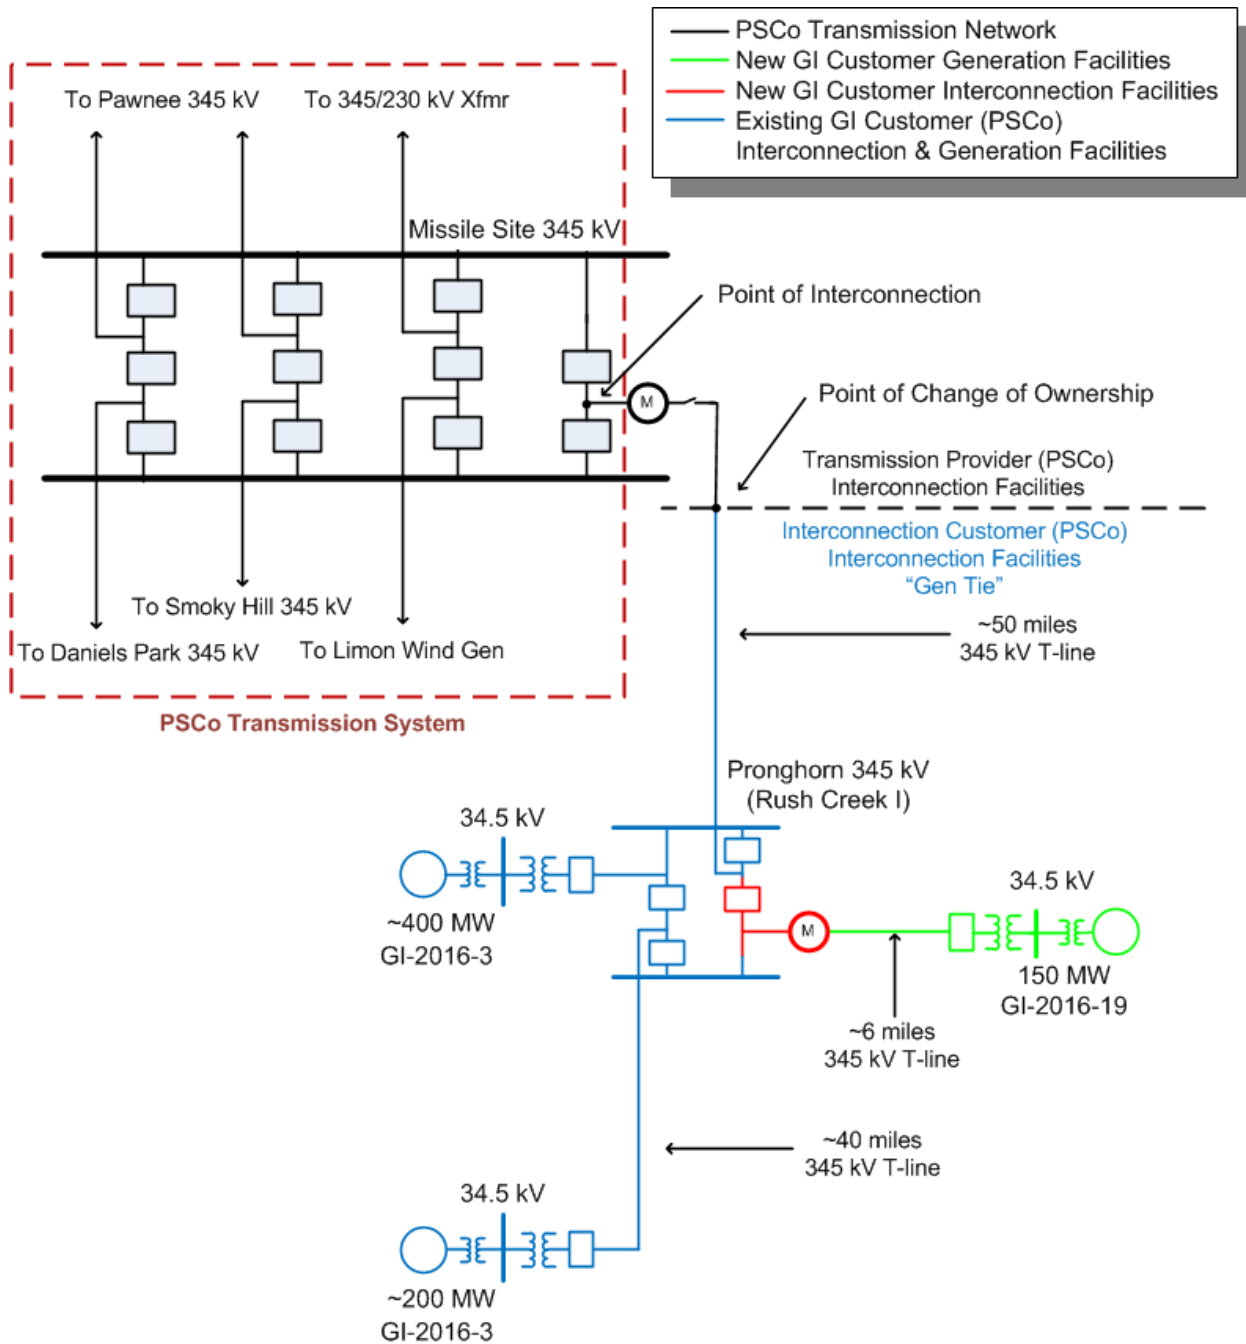


Figure 2: GI-2016-19 Interconnection to 345 kV Bus in Missile Site Substation

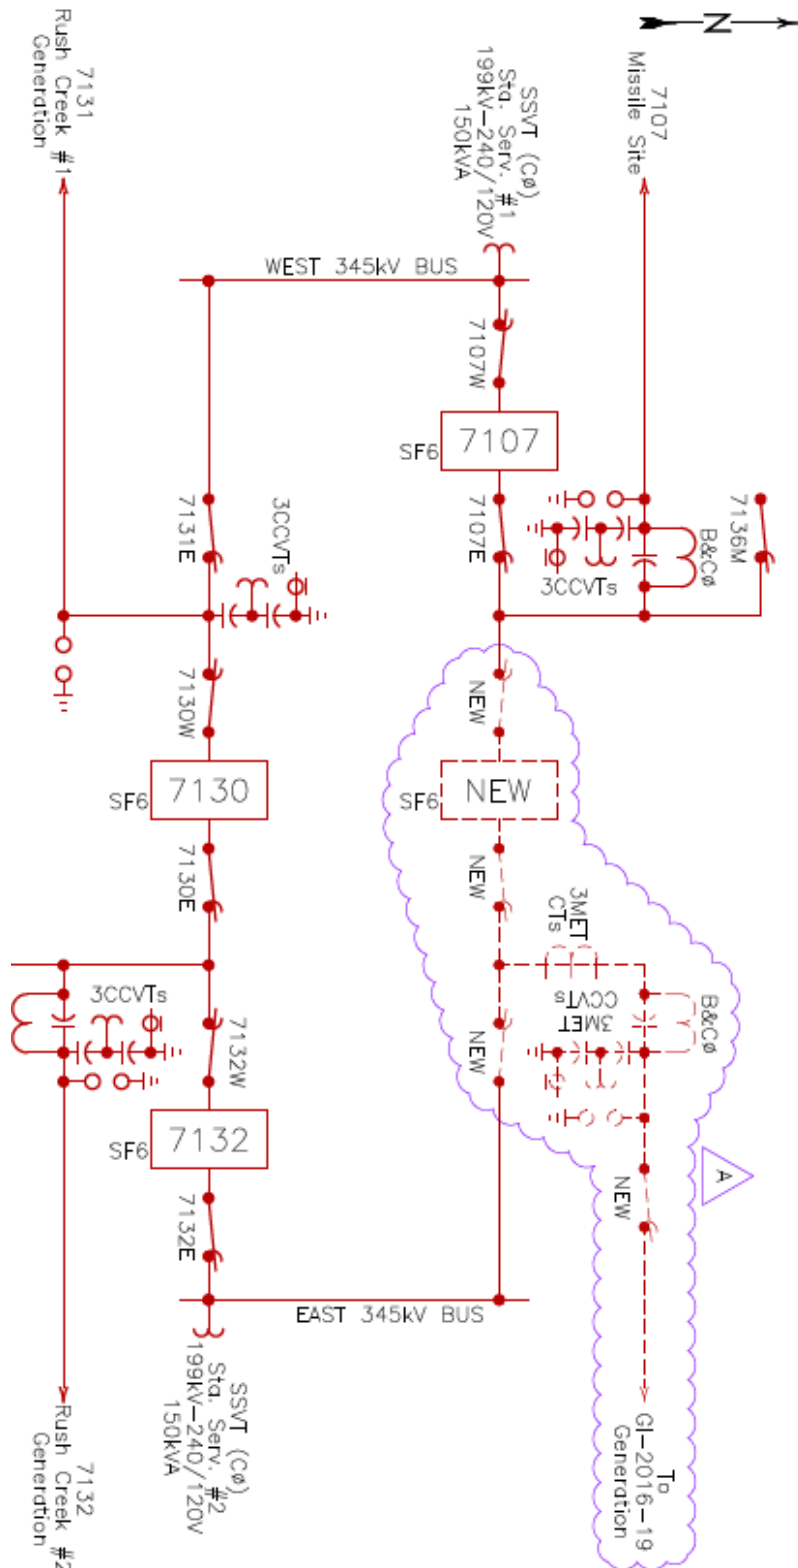


Figure 3: GI-2016-19 Physical Connection at Pronghorn Switching Station

Table 1 – PSCo Owned; Interconnection Customer Funded Interconnection Facilities

Element	Description	Cost Estimate (Millions)
PSCo’s Pronghorn 345kV Transmission Switching Station Interconnection Gen-Tie Line	Interconnect Customer to the proposed/planned Pronghorn 345kV Transmission Switching Station The new equipment includes: <ul style="list-style-type: none"> • One 345kV circuit breaker • Three 345kV disconnect switches • Associated communications, supervisory and SCADA equipment • Associated line relaying and testing • Associated bus, miscellaneous electrical equipment, cabling and wiring • Associated foundations and structures • Associated road and site development, fencing and grounding 	\$1.382
PSCo’s Pronghorn 345kV Transmission Switching Station Interconnection	Interconnect Customer to the proposed/planned Rush Creek II 345kV Transmission Switching Station The new equipment includes: <ul style="list-style-type: none"> • 345kV disconnect switches • 345kV arresters • Two sets (of 3) 345kV CT/PT metering units • Two 345kV line traps/tuner equipment • Station controls • Instrument transformers • Associated bus, wiring and equipment • Associated site development, grounding, foundations and structures • Associated transmission line communications, relaying and testing • 345kV transmission line tap/upgrades into substation. Last span to substation on Customer line. 	\$0.975
	Siting and Land Rights support for siting studies, land and ROW acquisition and construction.	\$0.040
	Total Cost Estimate for PSCo-Owned, Customer Funded Interconnection Facilities	\$2.397
Time Frame	Site, design, procure and construct	18 Months



Table 2 – PSCo Network Upgrades for Delivery

Element	Description	Cost Est. (Millions)
PSCo's Monaco 230kV Transmission Substation	Upgrade/replace limiting substation equipment to achieve required MVA ratings on circuit 5281 Monaco-Greenwood OH/UG Line: <ul style="list-style-type: none"> Six - 1272 dual jumpers 	\$0.022
	Total Cost Estimate for PSCo Network Upgrades for Delivery Facilities	\$0.022
Time Frame	Design, procure and construct	18 months

Cost Estimate Assumptions:

- Indicative level project cost estimates (IE's) for Interconnection Facilities were developed by PSCo Engineering. No level of accuracy is specified for IE's.
- Estimates are based on 2017 and similar type projects.
- AFUDC has been excluded.
- Labor is estimated for straight time only – no overtime included.
- Lead times for materials were considered for the schedule.
- The Customer's Generation Facility is not in PSCo's retail service territory. Therefore, no costs for retail load (distribution) facilities and metering required for station service are included in these estimates. .
- The substation land acquisition (40 acres) planned for Xcel's Pronghorn project will be sufficient for this project substation expansion and build-out. No additional land is required.
- PSCo (or our Contractor) crews will perform all construction, wiring, testing and commissioning for PSCo owned and maintained facilities.
- Assuming a CPCN will not be required for the interconnection at the Pronghorn Sub. authorization to proceed has been obtained.
- The Customer will be required to design, procure, install, own, operate and maintain a Load Frequency/Automated Generation Control (LF/AGC) RTU at their Customer Substation. PSCo / Xcel will need indications, readings and data from the LFAGC RTU.
- Customer will string OPGW fiber into Pronghorn Switching Station as part of the transmission line construction scope.
- No breaker replacements are needed in neighboring substations.

Appendix – Power Flow N-1 Contingency Analysis Results

High Coincidence Generation Dispatch at Pawnee & Missile Site:

Pawnee 230kV (100% Coal + 90% Gas + 40% Wind) = 1018 MW;

Missile Site 345kV Wind = 480 MW (80%); Missile Site 230kV Wind = 200 MW (80%)

600 MW output from GI-2016-3 is dispatched to sink at Blue Spruce, Rocky Mountain Energy Center, & Comanche

150 MW output from GI-2016-19 is dispatched to sink at Spindle, Rocky Mountain Energy Center & Comanche

**Table A.1 – Differential Impact³ of GI-2016-19 on Facility Loadings
With Pawnee – Daniels Park 345kV Project In-Service**

				Branch N-1 Loading Before 150 MW GI (600 MW Total Injection)		Branch N-1 Loading After 150 MW GI (750 MW Total Injection)			
Monitored Facility (Line or Transformer)	Type	Owner	Summer Normal (Continuous) Facility Rating in MVA	Flow in MVA	Flow in % of Summer Normal Rating	Flow in MVA	Flow in % of Summer Normal Rating	Differential Impact of GI-2016-19	N-1 Contingency Outage
Greenwood – Monaco 230 kV	Line	PSCo	404	404	100%	429	106%	6%	Smoky Hill -- Leetsdale 230 kV

³ Due to proposed 150 MW generation increase at Missile Site 345 kV Substation